




DIMENSION TABLE		
(A)	(B)	(C)
3'	3-3/4"	3'-9"
4'	3"	3'-0"
5'	2-1/4"	2'-3"
6'	1-1/2"	1'-6"
7'	3/4"	0'-9"
≥8'	0	0

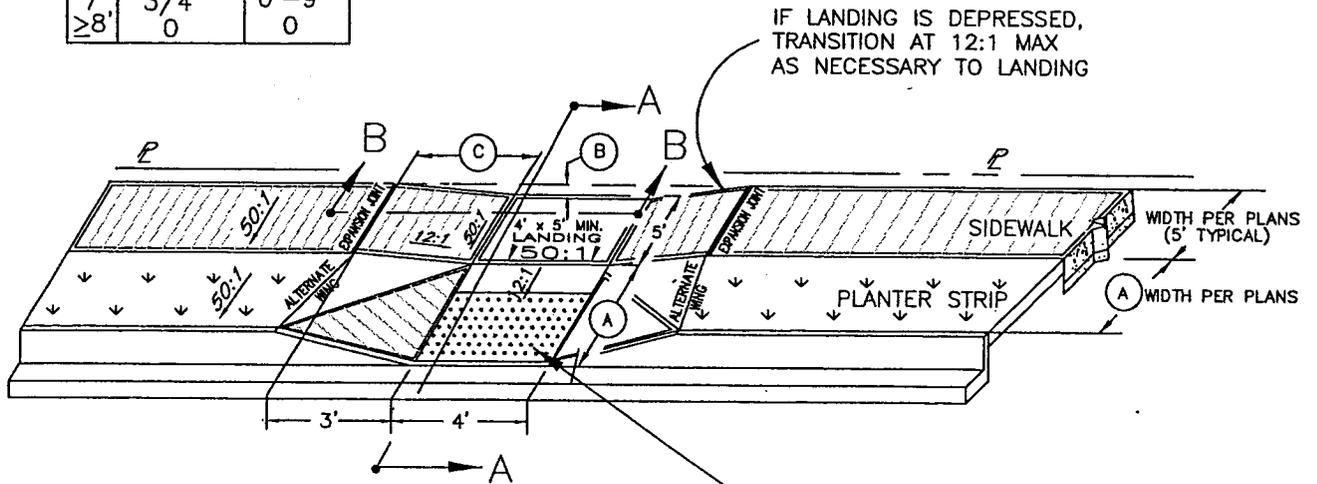

SECTION A - A

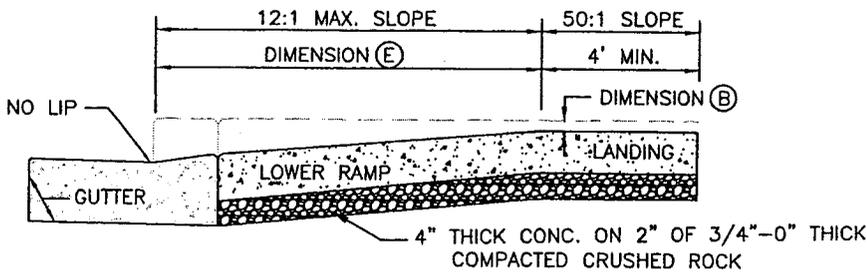

SECTION B - B

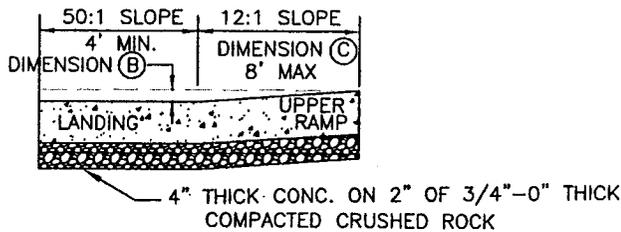

NOTES

- * NO ABOVE-GROUND FACILITIES (FIRE HYDRANTS, POWER POLES, CATCH BASINS, VALVES, J-BOXES, ETC.) SHALL BE PERMITTED WITHIN THE RAMP AREA
- * CURB RAMPS AT MARKED CROSSWALKS SHALL BE WHOLLY CONTAINED WITHIN THE MARKINGS (EXCLUDING CURB TRANSITIONS)
- * MINIMUM 4' x 4' LANDINGS SHALL BE PLACED AT THE TOP OF ALL RAMPS. LANDING SLOPE SHALL NOT EXCEED 50:1 IN ANY DIRECTION
- * RAMP SLOPE SHALL NOT EXCEED 12:1 OR LESS RELATIVE TO THE HORIZONTAL
- * ALL SURFACES SHALL HAVE A BROOM FINISH EXCEPT FOR RAMPS. RAMP SURFACE SHALL BE TEXTURED WITH RAISED DIAMOND PATTERN (SEE DETAIL)
- * SIDEWALKS, ACCESS RAMPS, AND RESIDENTIAL DRIVEWAYS SHALL BE 3000 PSI FIELD STRENGTH (3450 PSI LAB STRENGTH) 6.0 SACK MIX CONCRETE
- * CURBS & COMMERCIAL DRIVEWAYS SHALL BE 3500 PSI FIELD STRENGTH (4025 PSI LAB STRENGTH) 6.3 SACK MIX CONCRETE

V:\CITYSPEC\Standard Drawings - Revised\3-18.dwg- Revised.dwg. 06/06/2003 10:16:51 AM

NO	REVISION	DATE	BY	APPR.	<p>CITY OF SPRINGFIELD DEPT. OF PUBLIC WORKS</p>	<p>SIDEWALK ACCESS RAMP 'T' INTERSECTION - SETBACK SIDEWALK</p> <p><i>Al Peroutka</i> Al Peroutka City Engineer 2003</p>	<p>STANDARD DRAWING 3-18 2003</p>