


SECTION A - A

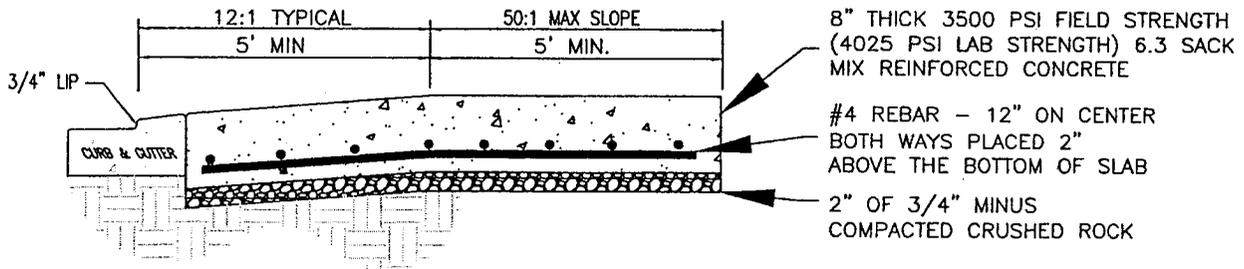

NOTES

- * NO ABOVE-GROUND FACILITIES (FIRE HYDRANTS, POWER POLES, CATCH BASINS, VALVES, J-BOXES, ETC.) SHALL BE PERMITTED WITHIN THE APRON OR RAMP AREA
- * DRIVEWAY (THROAT) WIDTH SHALL BE BETWEEN 24 FEET (MINIMUM) AND 35 FEET (MAXIMUM) IN ACCORDANCE WITH CITY PERMITS.
- * ALL SURFACES SHALL HAVE A BROOM FINISH.
- * REFER TO STANDARD DRAWING 3-XX FOR CURB CUT DETAILS
- * CONCRETE WITHIN APPROACH SHALL BE 8" THICK (MIN) CONCRETE ON 2" OF 3/4" MINUS CRUSHED ROCK.
- * REINFORCEMENT IS REQUIRED. USE #4 REBAR - 12" ON CENTER - BOTH WAYS - PLACED 2" ABOVE THE BOTTOM OF THE SLAB
- * A CONTRACTION (SCORE) JOINT SHALL BE ADDED IN THE CENTER OF THE APRON.
- * SIDEWALKS, ACCESS RAMPS, AND RESIDENTIAL DRIVEWAYS SHALL BE 3000 PSI FIELD STRENGTH (3450 PSI LAB STRENGTH) 6.0 SACK MIX CONCRETE
- * CURBS & COMMERCIAL DRIVEWAYS SHALL BE 3500 PSI FIELD STRENGTH (4025 PSI LAB STRENGTH) 6.3 SACK MIX CONCRETE

SIDEWALK ACCESS RAMP NOTES

THIS DRIVEWAY APPROACH MAY NOT BE USED AS A SIDEWALK ACCESS RAMP.

V:\CITYSPEC\Standard Drawings - Revised\3-22.dwg, 06/06/2003 10:11:17 AM

NO.	REVISION	DATE	BY	APPR.	CITY OF SPRINGFIELD SPRINGFIELD  DEPT. OF PUBLIC WORKS	COMMERCIAL DRIVEWAY APRON CURBSIDE SIDEWALK <i>Al Peroutka</i> Al Peroutka City Engineer 2003	STANDARD DRAWING 3-22 2003