


INLAND FOUNDRY CO. INC.
OR EQUAL
RING.....NO. 802
COVER.....NO. 802-2

MINIMUM RISER
UNPAVED STREETS - 1.0'
PAVED STREETS - 0.33'

SEE DETAIL 4-1A
FOR DIAMOND CUT FINISH

ALL CONSTRUCTION JOINTS
SHALL BE MORTARED

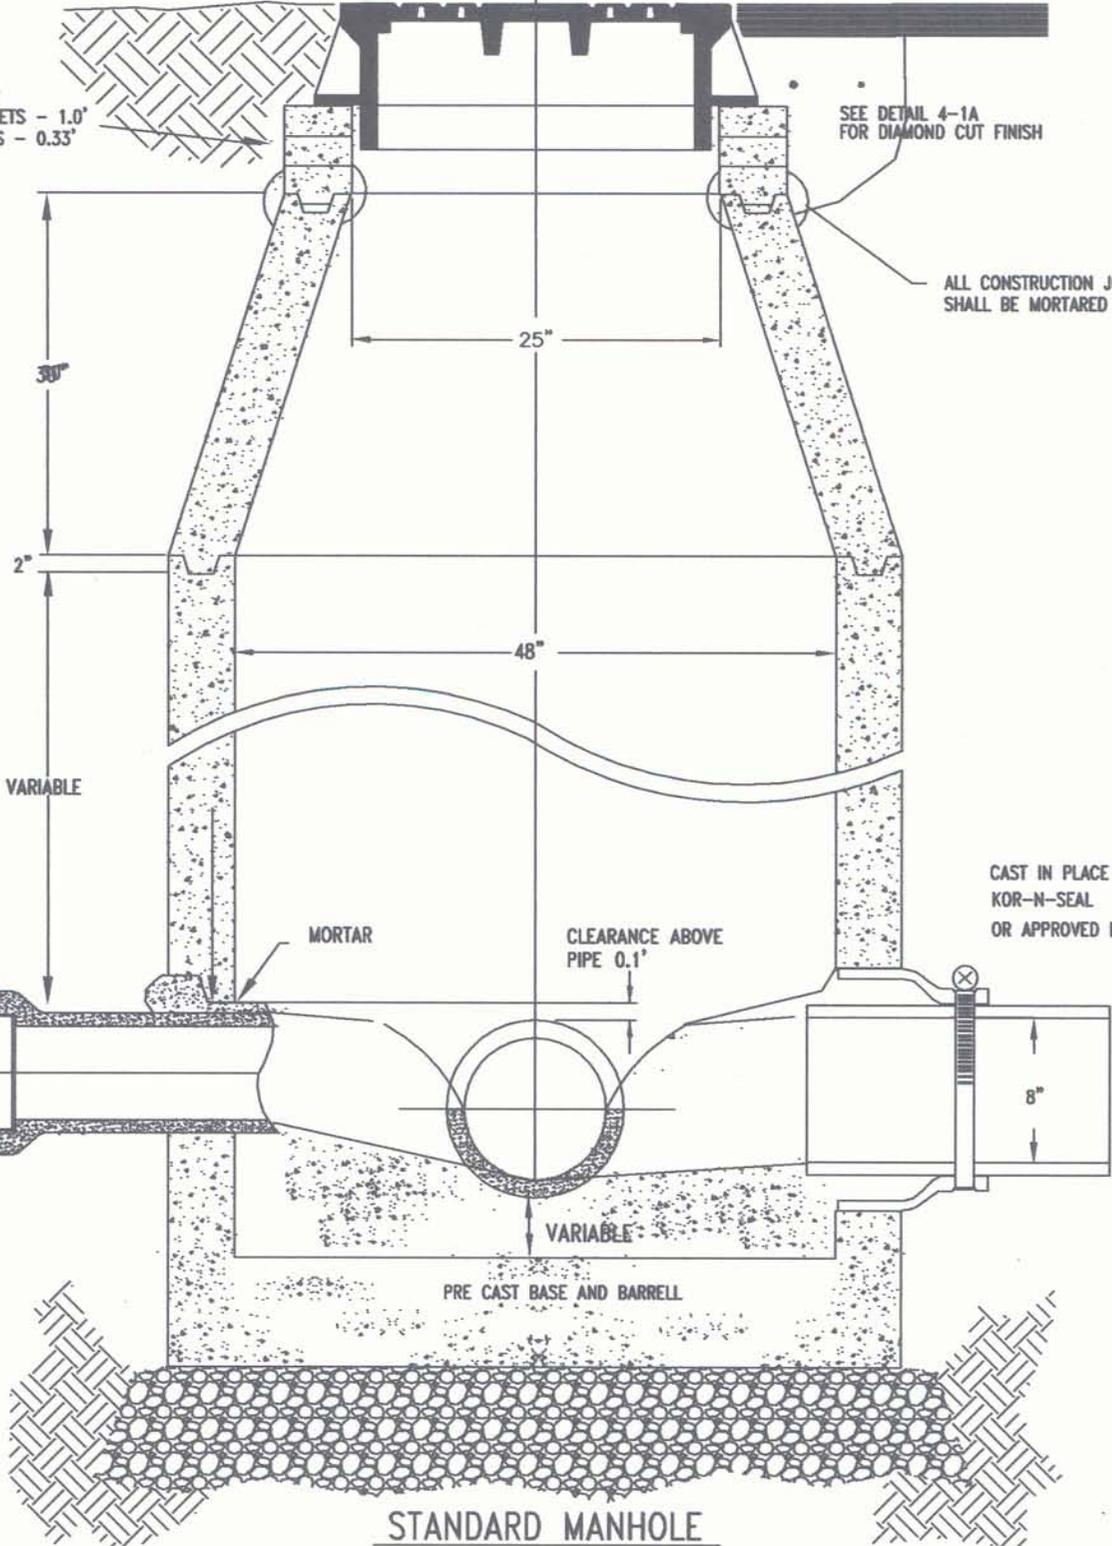

CAST IN PLACE BOOT
KOR-N-SEAL
OR APPROVED EQUAL

NOTE:
ALL PIPE CONNECTIONS
TO MANHOLES SHALL
BE CONCRETE

CONCRETE
OR MECH.
PLUG

PIPE

MORTAR

CLEARANCE ABOVE
PIPE 0.1'

VARIABLE

PRE CAST BASE AND BARRELL

STANDARD MANHOLE

NO	REVISION	DATE	BY	APPR.



STANDARD MANHOLE

Ken Vogoney
Ken Vogoney City Engineer

2006

STANDARD
DRAWING
4-1
2006