


V:\CITYSPEC\Standard Drawings - Revised\3-20.dwg, 06/06/2003 10:12:42 AM

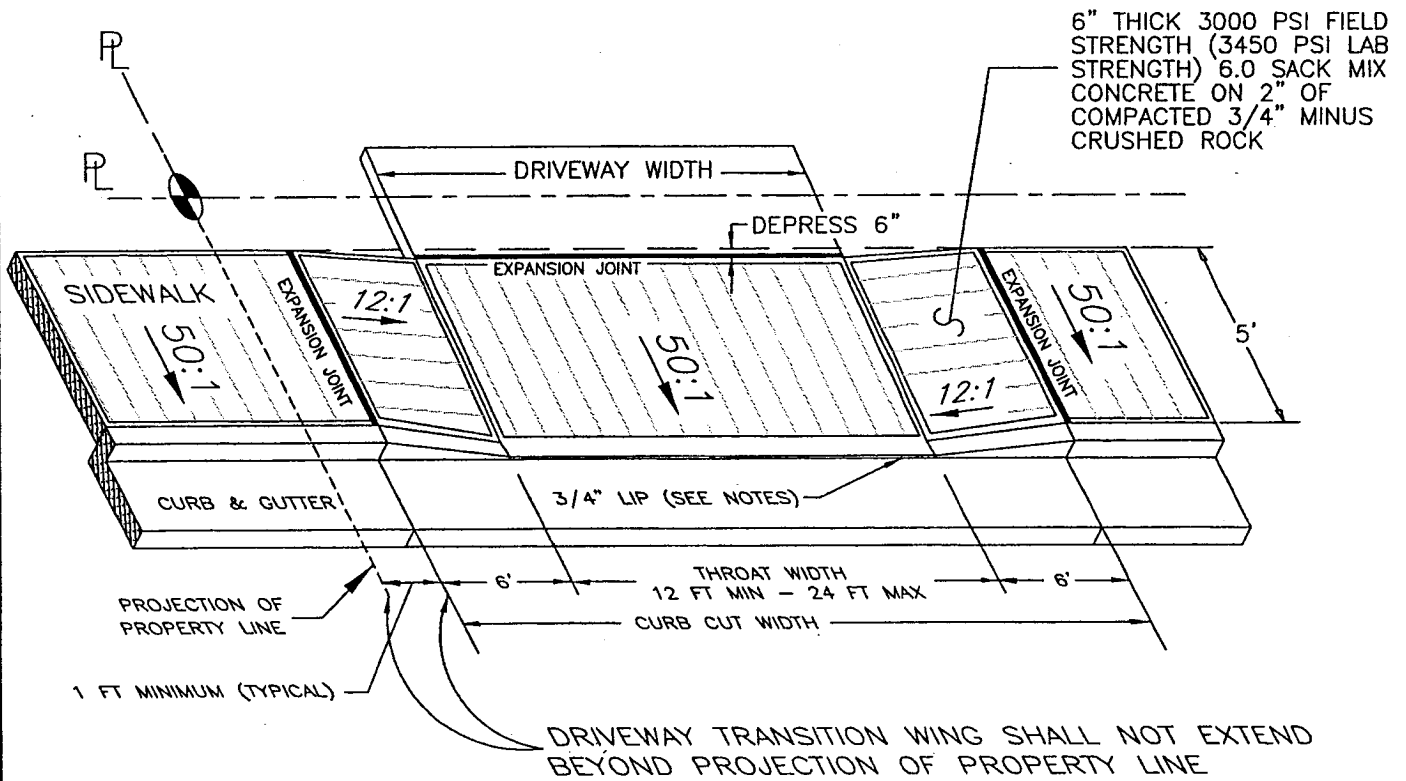


NOTES

- * NO ABOVE-GROUND FACILITIES (FIRE HYDRANTS, POWER POLES, CATCH BASINS, VALVES, J-BOXES, ETC.) SHALL BE PERMITTED WITHIN THE APRON AREA
- * THIS STANDARD DRAWING SHALL BE USED FOR SINGLE FAMILY HOMES AND DUPLEXES ONLY. REFER TO COMMERCIAL DRIVEWAY APRON DRAWING(S) FOR OTHER DEVELOPMENT TYPES
- * THROAT WIDTH SHALL BE BETWEEN 12 FEET (MINIMUM) AND 24 FEET (MAXIMUM)
- * ALL SURFACES SHALL HAVE A BROOM FINISH.
- * REFER TO STANDARD DRAWING 3-7 FOR CURB CUT DETAILS
- * CONCRETE IN APPROACH AND SIDEWALK BEHIND APPROACH SHALL BE 6" THICK (MIN) ON 2" OF 3/4" MINUS CRUSHED ROCK.
- * NO REINFORCEMENT IS REQUIRED
- * A CONTRACTION (SCORE) JOINT SHALL BE ADDED IN THE CENTER OF THE APRON WHEN THE THROAT WIDTH EXCEEDS 20 FT.
- * SIDEWALKS, ACCESS RAMPS, AND RESIDENTIAL DRIVEWAYS SHALL BE 3000 PSI FIELD STRENGTH (3450 PSI LAB STRENGTH) 6.0 SACK MIX CONCRETE
- * CURBS & COMMERCIAL DRIVEWAYS SHALL BE 3500 PSI FIELD STRENGTH (4025 PSI LAB STRENGTH) 6.3 SACK MIX CONCRETE

SIDEWALK ACCESS RAMP NOTES

- IF THIS DRIVEWAY APPROACH IS TO ALSO SERVE AS AN SIDEWALK ACCESS RAMP ALL OF THE FOLLOWING APPLY:
- * RAMP SLOPE SHALL NOT EXCEED 12:1 RELATIVE TO THE HORIZONTAL.
 - * NO LIP SHALL BE PLACED AT THE GUTTER BAR.

NO.	REVISION	DATE	BY	APPR.	CITY OF SPRINGFIELD  DEPT. OF PUBLIC WORKS	RESIDENTIAL DRIVEWAY APRON CURBSIDE SIDEWALK (FULLY DEPRESSED)	STANDARD DRAWING 3-20 2003